




PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 1

TABLE OF CONTENTS

SAMPLES SUBMITTED..... 2

PURPOSE OF TEST 3

PRODUCTS EVALUATED..... 4

SECTION A – CLEANING INTEGRALLY COLORED CMUs

DESCRIPTION OF PRODUCTS EVALUATED..... 5

TEST METHOD..... 5

TEST RESULTS 6

CONCLUSIONS 6

RECOMMENDATIONS 7

SECTION B – SURFACE ALTERATIONS

DESCRIPTION OF PRODUCTS EVALUATED..... 8

TEST METHOD..... 8

TEST RESULTS9-11

PHOTOGRAPHS OF CMUs AFTER SURFACE ALTERATIONS12

CONCLUSIONS13

RECOMMENDATIONS14

SECTION C – PROTECTIVE WATER REPELLENTS

DESCRIPTION OF PRODUCTS EVALUATED.....15

TEST METHOD.....15

TEST RESULTS16-18

CONCLUSIONS18

RECOMMENDATIONS19


ATTACHMENTS

Technical Services TECH Note RILEM Test Method No. II.4

Product Data literature for all products evaluated



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 2

FOR: John Stipp
cc: Perry Surber
John Bourne

SUBJECT: Irvin's Interstate Brick & Block
Indianapolis, IN

DATE: April 10, 2002

PROJECT: 0110-18 BP


SAMPLES SUBMITTED: Ten different colors of concrete masonry units (CMUs), nine split-face, nine smooth-face, and one ground-face (one of each)

<u>Sample</u>	<u>Color</u>	<u>Size</u>
Split-face CMU	"C-117" (Tan)	8" x 12" x 16"
Smooth-face CMU	"C-117" (Tan)	8" x 12" x 16"
Split-face CMU	"C-42" (Gray)	8" x 8" x 16"
Smooth-face CMU	"C-42" (Gray)	8" x 8" x 16"
Split-face CMU	"C-10" (Brown)	8" x 8" x 16"
Smooth-face CMU	"C-10" (Brown)	8" x 8" x 16"
Split-face CMU	"C-77" (Dark Red)	3½" x 8" x 16"
Smooth-face CMU	"C-77" (Dark Red)	3½" x 8" x 16"
Split-face CMU	"C-82" (Tan)	8" x 8" x 16"
Smooth-face CMU	"C-82" (Tan)	8" x 8" x 16"
Split-face CMU	"C-70" (Red)	8" x 8" x 16"
Smooth-face CMU	"C-70" (Red)	8" x 8" x 16"
Split-face CMU	"1-25" (Gray)	8" x 8" x 16"
Smooth-face CMU	"1-25" (Gray)	8" x 8" x 16"
Split-face CMU	"1-2" (Gray)	3½" x 8" x 16"
Smooth-face CMU	"1-2" (Gray)	3½" x 8" x 16"
Split-face CMU	"W-01" (White)	3½" x 12" x 16"
Smooth-face CMU	"W-01" (White)	3½" x 12" x 16"
Ground-face CMU	"1-1" (Gray)	8" x 8" x 16"

Submitted by: Perry Surber



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 3

PURPOSE OF TESTING

Ten different colors of integrally colored CMUs were submitted for testing using PROSOCO, Inc.'s new construction cleaning and water repellent products.

A. Cleaning Integrally Colored CMUs – Sure Klean[®] Custom Masonry Cleaner was tested at various dilutions for the removal of laboratory applied mortar from the CMUs.

To simulate new construction soiling, all CMUs are placed on a bench with finished surface facing upward. Hollow cylinders measuring 50 mm in diameter and 75 mm tall are positioned on top of each CMU and filled with a wet mixture of Ash Grove[®] Type S cementitious mortar. The wet, mortar-filled cylinder is allowed to remain in contact with the CMU for 10 minutes before removal.

Soiled CMUs are allowed to dry before test cleaning.

Heavy deposits of mortar are removed with dry scraping after 24 hours. Prepared cleaning solutions are then evaluated for their effectiveness in removing residual Ash Grove[®] Type S mortar staining after 14 days of curing.

Refer to “*Note: When cleaning integrally colored CMU” in the following section, “Surface Alteration Testing.”

B. Surface Alteration Testing – Sure Klean[®] Custom Masonry Cleaner was tested at various dilutions to determine if a cleaning program implemented to remove excess mortar and related new construction soiling would otherwise alter the appearance of cleaned surfaces. Surface Alteration was evaluated visually based upon perceived discoloration or erosion/etching of the masonry unit.

Aggregate Exposure is the visual examination of the CMU comparing aggregate exposure of the untreated control surface to surfaces cleaned with selected product(s) at given dilutions.

Surface Pigment Alteration/Removal* is the visual examination of the CMU comparing the surface pigmentation of the untreated control to surfaces cleaned with selected product(s) at given dilutions.

Matrix Erosion is the visual examination comparing the untreated control surface to surfaces cleaned with selected products at given dilutions looking for any potential erosion/digestion of the cementitious matrix of the CMU.

Staining is the visual examination for changes that are the result of a chemical reaction that leaves a staining precipitate.

The following is the scale used for reporting results of all categories:

0 – no change	3 – heavy
1 – slight	4 – excessive
2 – moderate	

*** NOTE: When cleaning integrally colored CMU.**


Integrally colored concrete masonry units (CMUs) frequently have high amounts of pigments concentrated on the surface of the cured concrete unit. Variation of surface pigment concentrations from one CMU to the next creates a blotchy appearance in the completed wall. Allowed to remain on the surface of the CMU, the weakly bound pigment will weather and streak, further detracting from the appearance of the completed CMU wall.

In addition to removing excess mortar and construction related soiling, the goal of any cleaning operation undertaken on integrally colored CMU should include removal of unnaturally high concentrations of surface pigment. By revealing the natural through-body color on the integrally colored unit, the overall color uniformity and weathering resistance of the completed CMU wall is improved.

C. Protective Water Repellents – Sure Klean[®] Custom Masonry Sealer and Sure Klean[®] Weather Seal Siloxane WB Concentrate were evaluated for their ability to provide water repellency to the submitted samples.



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 4

PRODUCTS EVALUATED FOR CLEANING AND SURFACE ALTERATION

SAMPLE	PRODUCT	DILUTION
All CMU samples	Sure Klean [®] Custom Masonry Cleaner	1:2, 1:4, 1:6


WATER REPELLENT PRODUCTS EVALUATED

SAMPLE	PRODUCT	DILUTION
All CMU samples	Sure Klean [®] Custom Masonry Sealer	Concentrate
	Sure Klean [®] Weather Seal Siloxane WB Concentrate	1:9

NOTE: Dilution ratios refer to parts concentrate : parts fresh water.



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 5

SECTION A – CLEANING INTEGRALLY COLORED CMUs

DESCRIPTION OF PRODUCTS EVALUATED – Cleaning

These cleaning trials were conducted to determine the optimal cleaning/cure time combination.

Sure Klean® Custom Masonry Cleaner – A general purpose, concentrated acidic cleaner for most custom masonry and colored concrete. Removes concrete splashes, excess mortar, mud, heavy efflorescence and surface soiling, leaving the masonry clean and uniform with no acid burning or streaking. Liquid concentrate for dilution with 2-6 parts water. Apply by brush or low-pressure spray.

TEST METHOD – Cleaning


Dilution ratios refer to mixtures of parts concentrated cleaner : parts fresh water. Chemical cleaners were evaluated using the following procedure:

1. Prewet the surface with water.
2. Apply the cleaner at the appropriate dilutions.
3. Allow appropriate exposure time:
 Custom Masonry Cleaner 3 minutes
4. Reapply the product and moderately agitate with a brush.
5. Pressure rinse thoroughly.*
6. Allow the surface to dry for at least 18 hours and visually examine.

* Pressure rinsing was conducted at approximately 1300 psi with a warm water flow rate of 1.9 gallons per minute.



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 6

TEST RESULTS – Cleaning

SAMPLE	CLEANER	DILUTION	CURE	% MORTAR REMOVAL
All Colors of Split-face CMUs	Custom Masonry Cleaner	1:2	14 day	99%
		1:4		99%
		1:6		99%
All Colors of Smooth-face CMUs	Custom Masonry Cleaner	1:2	14 day	99%
		1:4		99%
		1:6		99%
All Colors of Ground-face CMUs	Custom Masonry Cleaner	1:2	14 day	99%
		1:4		99%
		1:6		99%

NOTE: Due to limited substrate only a 14 day mortar cure was tested.

CONCLUSIONS – Cleaning


Based on the test data, all dilutions of Sure Klean[®] Custom Masonry Cleaner efficiently cleaned all of the submitted CMUs. Use higher concentrations and surface agitation to maximize aggregate exposure. Use low concentration and surface agitation to minimize aggregate exposure.

All dilutions of Sure Klean[®] Custom Masonry Cleaner tested affected the split-face CMUs in a similar manner, removing slight to heavy concentrations of pigmented matrix from the CMUs, exposing small and large aggregate, and enhancing the natural appearance of the integrally colored concrete masonry unit.

All dilutions of Sure Klean[®] Custom Masonry Cleaner tested affected the smooth and ground-face CMUs in a similar manner, removing slight to moderate concentrations of pigmented matrix from the CMUs, exposing small and large aggregate, and enhancing the natural appearance of the integrally colored concrete masonry unit.



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 7

RECOMMENDATIONS – Cleaning

Recommendations for cleaning each type of CMU submitted by Irvin's Interstate Brick & Block, Indianapolis, IN are provided in the chart below. Recommendations are based on the optimum dilution for the most complete removal of mortar while limiting surface alterations.


<u>BLOCK</u>	<u>COLOR</u>	<u>NEW CONSTRUCTION CLEANING</u> <u>(Type S, 14 Day Cleaning)</u>
Split-face CMU	"C-117" (Tan)	CMC (1:6)
Smooth-face CMU	"C-117" (Tan)	CMC (1:6)
Split-face CMU	"C-42" (Gray)	CMC (1:6)
Smooth-face CMU	"C-42" (Gray)	CMC (1:6)
Split-face CMU	"C-10" (Brown)	CMC (1:6)
Smooth-face CMU	"C-10" (Brown)	CMC (1:6)
Split-face CMU	"C-77" (Dark Red)	CMC (1:6)
Smooth-face CMU	"C-77" (Dark Red)	CMC (1:6)
Split-face CMU	"C-82" (Tan)	CMC (1:6)
Smooth-face CMU	"C-82" (Tan)	CMC (1:6)
Split-face CMU	"C-70" (Red)	CMC (1:6)
Smooth-face CMU	"C-70" (Red)	CMC (1:6)
Split-face CMU	"1-25" (Gray)	CMC (1:6)
Smooth-face CMU	"1-25" (Gray)	CMC (1:6)
Split-face CMU	"1-2" (Gray)	CMC (1:6)
Smooth-face CMU	"1-2" (Gray)	CMC (1:6)
Split-face CMU	"W-01" (White)	CMC (1:6)
Smooth-face CMU	"W-01" (White)	CMC (1:6)
Ground-face CMU	"1-1" (Gray)	CMC (1:6)

NOTE: To remove excess mortar while minimizing aggregate exposure and color enhancement, clean within 7 days of completion using Sure Klean[®] Custom Masonry Cleaner diluted with 6 parts fresh water.

Apply all products in accordance with the manufacturer's recommendation provided on container labels and product data sheets. On-site testing should be conducted to determine the most appropriate water-repellent product and procedures for a particular project. See product literature for additional application and product information.



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 8

SECTION B – SURFACE ALTERATIONS

DESCRIPTION OF PRODUCTS EVALUATED – Surface Alterations

Sure Klean® Custom Masonry Cleaner – A general purpose, concentrated acidic cleaner for most custom masonry and colored concrete. Removes concrete splashes, excess mortar, mud, heavy efflorescence and surface soiling, leaving the masonry clean and uniform with no acid burning or streaking. Liquid concentrate for dilution with 2-6 parts water. Apply by brush or low-pressure spray.

TEST METHOD – Surface Alterations


Dilution ratios refer to mixtures of parts concentrated cleaner : parts fresh water. Chemical cleaners were evaluated using the following procedure:

1. Prewet the surface with water.
2. Apply the cleaner at the appropriate dilutions.
3. Allow appropriate exposure time:
 Custom Masonry Cleaner 3 minutes
4. Reapply the products and moderately agitate with a brush.
5. Pressure rinse thoroughly.*
6. Allow the surface to dry for at least 18 hours and visually examine.

* Pressure rinsing was conducted at approximately 1300 psi with a warm water flow rate of 1.9 gallons per minute.



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 9

TEST RESULTS – Surface Alterations

Substrate: Split-face CMU		Pigment Color: "C-117"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Smooth-face CMU		Pigment Color: "C-117"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	2	1	2	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Split-face CMU		Pigment Color: "C-42"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Smooth-face CMU		Pigment Color: "C-42"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	2	1	2	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Split-face CMU		Pigment Color: "C-10"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Smooth-face CMU		Pigment Color: "C-10"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	2	1	2	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Split-face CMU		Pigment Color: "C-77"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Smooth-face CMU		Pigment Color: "C-77"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0

Scale used for reporting results of all categories

0 – no change

3 – heavy

1 – slight

4 – excessive

2 – moderate



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 10

TEST RESULTS – Surface Alterations Continued


Substrate: Split-face CMU		Pigment Color: "C-82"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	3	1	3	0
Custom Masonry Cleaner	1:4	2	1	2	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Smooth-face CMU		Pigment Color: "C-82"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Split-face CMU		Pigment Color: "C-70"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Smooth-face CMU		Pigment Color: "C-70"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	2	1	2	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Split-face CMU		Pigment Color: "1-25"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Smooth-face CMU		Pigment Color: "1-25"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Split-face CMU		Pigment Color: "1-2"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	2	1	2	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Smooth-face CMU		Pigment Color: "1-2"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0

Scale used for reporting results of all categories

0 – no change	3 – heavy
1 – slight	4 – excessive
2 – moderate	



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 11

TEST RESULTS – Surface Alterations Continued


Substrate: Split-face CMU		Pigment Color: "W-01"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Smooth-face CMU		Pigment Color: "W-01"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	2	1	2	0
Custom Masonry Cleaner	1:6	1	1	1	0
Substrate: Ground-face CMU		Pigment Color: "1-1"			
Product	Dilution	Aggregate Exposure	Surface Pigment Alteration/Removal	Matrix Erosion	Staining
Custom Masonry Cleaner	1:2	2	1	2	0
Custom Masonry Cleaner	1:4	1	1	1	0
Custom Masonry Cleaner	1:6	1	1	1	0

Scale used for reporting results of all categories

0 – no change	3 – heavy
1 – slight	4 – excessive
2 – moderate	



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 12

PHOTO A – Split-face CMU “C-70” cleaned with Custom Masonry Cleaner



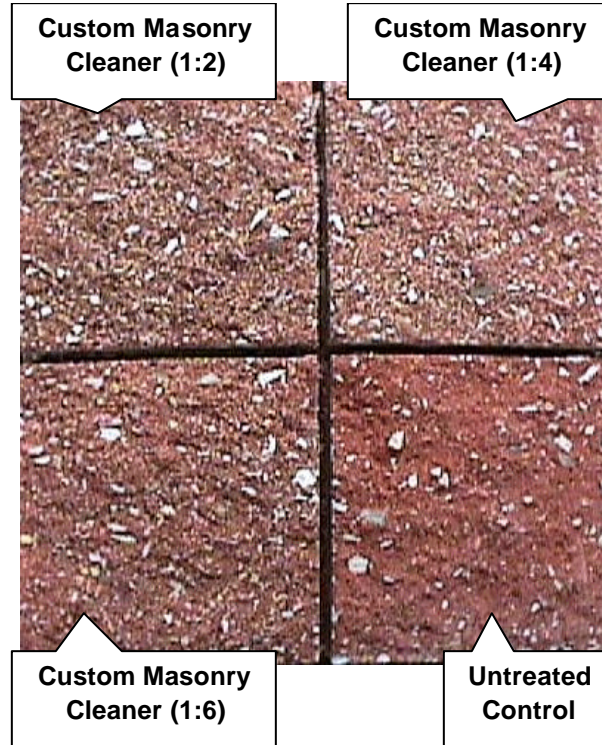


PHOTO B – Smooth-face CMU “C-70” cleaned with Custom Masonry Cleaner



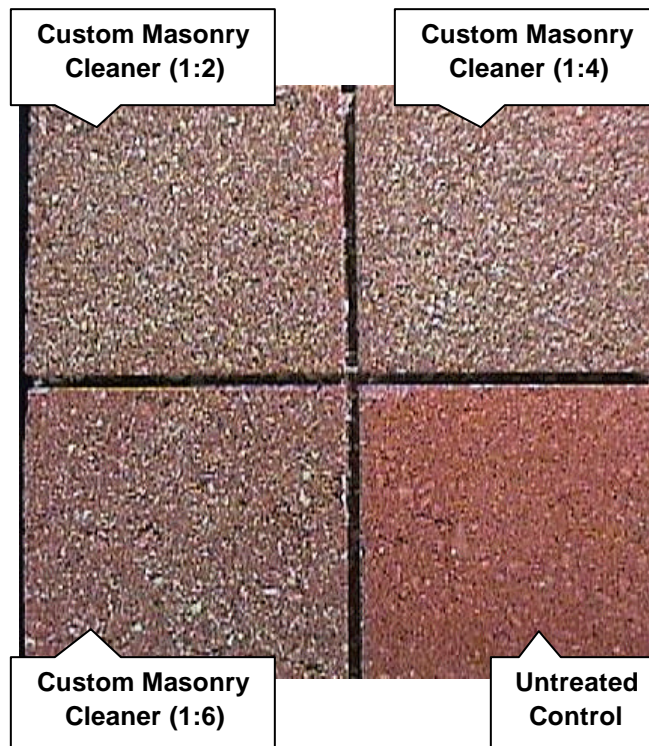

PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 13

CONCLUSIONS – Surface Alterations

Based on test data, all dilutions of Sure Klean[®] Custom Masonry Cleaner tested affected the split-face CMUs in a similar manner, removing slight to heavy concentrations of pigmented matrix from the CMUs, exposing small and large aggregate, and enhancing the natural appearance of the integrally colored concrete masonry unit.

All dilutions of Sure Klean[®] Custom Masonry Cleaner tested affected the smooth and ground-face CMUs in a similar manner, removing slight to moderate concentrations of pigmented matrix from the CMUs, exposing small and large aggregate, and enhancing the natural appearance of the integrally colored concrete masonry unit.

Use higher concentrations and surface agitation to maximize aggregate exposure. Use low concentration and surface agitation to minimize aggregate exposure.



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 14

RECOMMENDATIONS – Surface Alterations

Recommendations for surface alterations for each type of CMU submitted by Irvin's Interstate Brick & Block, Indianapolis, IN are provided in the chart below. Recommendations are based on the optimum dilution for most complete removal of mortar while limiting surface alterations.

<u>BLOCK</u>	<u>COLOR</u>	<u>SURFACE ALTERATIONS</u>
Split-face CMU	"C-117" (Tan)	CMC (1:6)
Smooth-face CMU	"C-117" (Tan)	CMC (1:6)
Split-face CMU	"C-42" (Gray)	CMC (1:6)
Smooth-face CMU	"C-42" (Gray)	CMC (1:6)
Split-face CMU	"C-10" (Brown)	CMC (1:6)
Smooth-face CMU	"C-10" (Brown)	CMC (1:6)
Split-face CMU	"C-77" (Dark Red)	CMC (1:6)
Smooth-face CMU	"C-77" (Dark Red)	CMC (1:6)
Split-face CMU	"C-82" (Tan)	CMC (1:6)
Smooth-face CMU	"C-82" (Tan)	CMC (1:6)
Split-face CMU	"C-70" (Red)	CMC (1:6)
Smooth-face CMU	"C-70" (Red)	CMC (1:6)
Split-face CMU	"1-25" (Gray)	CMC (1:6)
Smooth-face CMU	"1-25" (Gray)	CMC (1:6)
Split-face CMU	"1-2" (Gray)	CMC (1:6)
Smooth-face CMU	"1-2" (Gray)	CMC (1:6)
Split-face CMU	"W-01" (White)	CMC (1:6)
Smooth-face CMU	"W-01" (White)	CMC (1:6)
Ground-face CMU	"1-1" (Gray)	CMC (1:6)

NOTE: To remove excess mortar while minimizing aggregate exposure and color enhancement, clean within 7 days of completion using Sure Klean[®] Custom Masonry Cleaner diluted with 6 parts fresh water.

Apply all products in accordance with the manufacturer's recommendation provided on container labels and product data sheets. On-site testing should be conducted to determine the most appropriate water-repellent product and procedures for a particular project. See product literature for additional application and product information.



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 15

SECTION C – PROTECTIVE WATER REPELLENTS

The testing described below evaluates the suitability of water repellent treatments.

The surface treatments evaluated were selected for their suitability for application based on the following selection criteria:

1. Weatherproofing properties
2. Color change
3. Ease of application

DESCRIPTIONS OF PRODUCTS EVALUATED – Protective Water Repellents

Sure Klean® Custom Masonry Sealer – A clear, solvent-based silicone elastomer formulated to weatherproof custom masonry units, cast stone, and concrete block without altering the natural appearance. Custom Masonry Sealer penetrates and fills pores to prevent water penetration through exterior walls exposed to normal weathering as well as long-lasting protection against many types of graffiti.

Sure Klean® Weather Seal Siloxane WB Concentrate – A self-emulsifying water-repellent concentrate designed for dilution with fresh water at the job site. This solvent-free blend of silanes and oligomeric alkoxy siloxanes mixes easily with water to produce a penetrating water-repellent ideal for application to dense or porous masonry surfaces.

SAMPLE PREPARATION – Protective Water Repellents

The submitted blocks were scored, allowed to dry, and to reabsorb atmospheric humidity for 24 hours prior to treatment. The treatment method consisted of a wet-on-wet brush application. All treatments were allowed to cure at least 72 hours prior to testing.


TEST METHODS – Protective Water Repellents

Water Absorption Tube Test: RILEM II.4, 60 mph, 20 Minutes

The water absorption tube test simulating wind driven rain conditions was performed. This test simulates 60 mile per hour wind driven rain conditions for a period of 20 minutes.



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 16


TEST RESULTS – Protective Water Repellents

Water Absorption Tube Test: RILEM II.4, 60 mph, 20 Minutes

	RESULTS
Split-face CMU "C-117"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	<40 mph
Smooth-face CMU "C-117"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	57 mph
Split-face CMU "C-42"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	57 mph
Smooth-face CMU "C-42"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	60 mph
Split-face CMU "C-10"	
Untreated Control	<40 mph
Custom Masonry Sealer	59 mph
Siloxane WB Concentrate (1:9)	56 mph
Smooth-face CMU "C-10"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	60 mph
Split-face CMU "C-77"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	55 mph
Smooth-face CMU "C-77"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	60 mph



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 17

TEST RESULTS – Protective Water Repellents

Split-face CMU "C-82"	
Untreated Control	<40 mph
Custom Masonry Sealer	57 mph
Siloxane WB Concentrate (1:9)	58 mph
Smooth-face CMU "C-82"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	58 mph
Split-face CMU "C-70"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	<40 mph
Smooth-face CMU "C-70"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	60 mph
Split-face CMU "1-25"	
Untreated Control	<40 mph
Custom Masonry Sealer	58 mph
Siloxane WB Concentrate (1:9)	58 mph
Smooth-face CMU "1-25"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	60 mph
Split-face CMU "1-2"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	60 mph
Smooth-face CMU "1-2"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	60 mph



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 18

TEST RESULTS – Protective Water Repellents

Split-face CMU "W-01"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	<40 mph
Smooth-face CMU "W-01"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	<40 mph
Ground-face CMU "1-1"	
Untreated Control	<40 mph
Custom Masonry Sealer	60 mph
Siloxane WB Concentrate (1:9)	60 mph

CONCLUSIONS – Protective Water Repellents

Based upon laboratory evaluations, Sure Klean[®] Custom Masonry Sealer provided above average water repellency on all of the submitted split-face and smooth-face CMUs. Sure Klean[®] Weather Seal Siloxane WB Concentrate diluted with nine parts fresh water provided above average water repellency to all submitted CMUs except for "C-117", "C-70", and "W-01".



PALLET CARD PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 19

RECOMMENDATIONS – Protective Water Repellents


Recommendations for water repellent treatments for each type of CMU submitted by Irvin's Interstate Brick & Block, Indianapolis, IN are provided in the chart below. Recommendations are based on the treatment that proved most effective and can provide water repellency on all types submitted if possible.

<u>BLOCK</u>	<u>COLOR</u>	<u>WATER REPELLENT</u>
Split-face CMU	"C-117" (Tan)	Custom Masonry Sealer
Smooth-face CMU	"C-117" (Tan)	Custom Masonry Sealer
Split-face CMU	"C-42" (Gray)	Custom Masonry Sealer
Smooth-face CMU	"C-42" (Gray)	Custom Masonry Sealer
Split-face CMU	"C-10" (Brown)	Custom Masonry Sealer
Smooth-face CMU	"C-10" (Brown)	Custom Masonry Sealer
Split-face CMU	"C-77" (Dark Red)	Custom Masonry Sealer
Smooth-face CMU	"C-77" (Dark Red)	Custom Masonry Sealer
Split-face CMU	"C-82" (Tan)	Custom Masonry Sealer
Smooth-face CMU	"C-82" (Tan)	Custom Masonry Sealer
Split-face CMU	"C-70" (Red)	Custom Masonry Sealer
Smooth-face CMU	"C-70" (Red)	Custom Masonry Sealer
Split-face CMU	"1-25" (Gray)	Custom Masonry Sealer
Smooth-face CMU	"1-25" (Gray)	Custom Masonry Sealer
Split-face CMU	"1-2" (Gray)	Custom Masonry Sealer
Smooth-face CMU	"1-2" (Gray)	Custom Masonry Sealer
Split-face CMU	"W-01" (White)	Custom Masonry Sealer
Smooth-face CMU	"W-01" (White)	Custom Masonry Sealer
Ground-face CMU	"1-1" (Gray)	Custom Masonry Sealer

Apply all products in accordance with the manufacturer's recommendation provided on container labels and product data sheets. On-site testing should be conducted to determine the most appropriate water-repellent product and procedures for a particular project. See product literature for additional application and product information.

Jason L. Anderson
Materials Testing Technician

JLA/



Laboratory Report

Pallet Card Program Evaluation

**Irvin's Interstate Brick & Block
Indianapolis, IN**

Project No. 0110-18 BP

Prepared For:

**John Stipp
Irvin's Interstate Brick & Block
P.O. Box 19783
Indianapolis, IN 46219**

Prepared By:



***PROSOCO, Inc.
April 2002***