




PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Table of Contents

Submitted Information..... 1

Purpose of Testing..... 2

Products Evaluated..... 3

New Construction Cleaning 4

 Description of Products Evaluated – New Construction Cleaning 4

 Test Method – New Construction Cleaning 4

 Test Results – New Construction Cleaning 5

 Test Results – Limiting Surface Alterations 8

 Photographs – New Construction Cleaning 11

 Photographs – Limiting Surface Alterations 13

 Conclusions – New Construction Cleaning 14

 Recommendations – New Construction Cleaning 14

Protective Water Repellents..... 15

 Description of Products Evaluated – Protective Water Repellents 15

 Sample Preparation – Protective Water Repellents 15

 Test Methods – Protective Water Repellents 16

 Test Results – Protective Water Repellents 17

 Photographs – Protective Water Repellents 19

 Conclusions – Protective Water Repellents 20

 Recommendations – Protective Water Repellents 20

Graffiti Control..... 21

 Description of Products Evaluated – Graffiti Control 21

 Sample Preparation – Graffiti Control 22

 Test Method – Graffiti Control 22

 Test Results – Graffiti Control 23

 Photographs – Graffiti Control 26

 Conclusions – Graffiti Control 27

 Recommendations – Graffiti Control 27


Attachments

 Technical Services TECH Note RILEM Tube Test Procedures

 Product Data literature for all products evaluated



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 1

Submitted Information

For: Mike Burdette
cc: Steve Dean
Paul Tessier
Subject: Palmetto Brick Company
Wallace, SC

Date:

Project: 0509-06 PTP


Samples Submitted: 18 types of clay brick

Name	Finish	Color	Size
"Ashland"	Wire-cut	Dark Brown/Gray	7 1/2" x 2 3/4" x 3 1/4"
"Birchwood Blend"	Wire-cut	Dark Brown/Gray	7 1/2" x 2 3/4" x 3 1/4"
"Black Wire-cut"	Wire-cut	Brown/Dark Brown	7 1/2" x 2 3/4" x 3 1/4"
"Brown Wire-cut"	Wire-cut	Brown/Orange	7 1/2" x 2 3/4" x 3 1/4"
"Buffstone"	Wire-cut	Yellow	7 1/2" x 2 3/4" x 3 1/4"
"Chocolate Wire-cut"	Wire-cut	Brown	7 1/2" x 2 3/4" x 3 1/4"
"Dark Red Wire-cut"	Wire-cut	Dark Red	7 1/2" x 2 3/4" x 3 1/4"
"Greystone .25"	Wire-cut	Light Tan	7 1/2" x 2 3/4" x 3 1/4"
"Greystone .75"	Wire-cut	Tan	7 1/2" x 2 3/4" x 3 1/4"
"Greystone 1.25"	Wire-cut	Brown	7 1/2" x 2 3/4" x 3 1/4"
"Greystone 2.0"	Wire-cut	Brown	7 1/2" x 2 3/4" x 3 1/4"
"Hampton"	Wire-cut	Red/Charcoal	7 1/2" x 2 3/4" x 3 1/4"
"Jamestown"	Wire-cut	Orange/Red	7 1/2" x 2 3/4" x 3 1/4"
"Kingsmill"	Wire-cut	Red	7 1/2" x 2 3/4" x 3 1/4"
"London Blast"	Wire-cut	Dark Brown	7 1/2" x 2 3/4" x 3 1/4"
"Old Marlborough"	Wire-cut	Orange/Red	7 1/2" x 2 3/4" x 3 1/4"
"Red Wire-cut"	Wire-cut	Red	7 1/2" x 2 3/4" x 3 1/4"
"Savannah River"	Wire-cut	Brown/Tan	7 1/2" x 2 3/4" x 3 1/4"

Submitted by: Mike Burdette



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 2

Purpose of Testing

Eighteen types of clay brick were submitted to PROSOCO, Inc.'s Testing Laboratory with a request to determine the optimal cleaning/cure time combination to most efficiently remove Type S mortar from the submitted clay brick while limiting surface alterations to the decorative finish. Additionally, the effectiveness of water repellents and graffiti control products suitable for clay brick were evaluated.

New Construction Cleaning – Enviro Klean[®] Safety Klean, Sure Klean[®] Vana Trol[®] and/or Sure Klean[®] 600 Detergent were tested at various dilutions to determine the optimal cleaning/cure time combination to most efficiently remove Type S mortar from the submitted clay brick while limiting surface alterations to the decorative finish. The surface alteration evaluation was visually determined based upon perceived discoloration or erosion/etching of the clay brick.

To simulate new construction soiling, all samples were placed on a bench with finished surface facing upward. Hollow cylinders measuring 50 mm in diameter and 75 mm tall were positioned on top of each brick and filled with a wet mixture of Type S cementitious mortar. The wet mortar-filled cylinder was allowed to remain in contact with the brick for 10 minutes before removal. Soiled brick were allowed to dry before test cleaning.

Heavy deposits of mortar were removed with dry scraping after 24 hours. Prepared cleaning solutions were then evaluated for their effectiveness in removing any residual Type S mortar after 3, 7, and 14 days of curing. A visual examination was also made to determine if the tested cleaners caused any surface alterations to the submitted clay brick based on the following:

Surface Finish Removal is the visual examination of the brick comparing the surface finish of the untreated control surface to the surface finish cleaned with selected product(s) at given dilutions.

Substrate Deterioration is the visual examination of the brick comparing the surface of the untreated control to surfaces cleaned with selected product(s) at given dilutions looking for any potential erosion/digestion of the brick.

Color Change is the visual examination comparing the color of the untreated control surface to color of surfaces cleaned with selected products at given dilutions.


Staining is the visual examination for changes that are the result of a chemical reaction that leaves a staining precipitate.

Protective Water Repellents – Sure Klean[®] Weather Seal Blok-Guard[®] & Graffiti Control, Sure Klean[®] Weather Seal Siloxane WB Concentrate and Sure Klean[®] Weather Seal Siloxane PD were evaluated for their ability to provide water repellency to the submitted clay brick.

Graffiti Control – Sure Klean[®] Weather Seal Blok-Guard[®] & Graffiti Control was evaluated on the submitted clay brick for its ability to provide graffiti control. Sure Klean[®] Fast Acting Stripper and Defacer Eraser[®] Graffiti Wipe were evaluated for their ability to remove graffiti from the submitted clay brick.



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Products Evaluated

New Construction Cleaning Products Evaluated

Sample	Product	Dilution
"Ashland" "Birchwood Blend" "Black Wire-cut" "Brown Wire-cut" "Buffstone" "Chocolate Wire-cut" "Greystone .25" "Greystone .75" "Greystone 1.25" "Greystone 2.0" "Hampton" "Jamestown" "Kingsmill" "London Blast" "Old Marlborough" "Savannah River"	Sure Klean® Vana Trol®	1:6, 1:8
	Enviro Klean® Safety Klean	1:2, 1:3
"Dark Red Wire-cut" "Red Wire-cut"	Sure Klean® 600 Detergent	1:6, 1:8
	Enviro Klean® Safety Klean	1:2, 1:3

Protective Water Repellent Products Evaluated

Sample	Product	Dilution
All Submitted Clay Brick	Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	Concentrate
	Sure Klean® Weather Seal Siloxane WB Concentrate	1:9
	Sure Klean® Weather Seal Siloxane PD	Concentrate

Graffiti Repellents Evaluated

Sample	Product	Dilution
All Submitted Clay Brick	Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	Concentrate


Graffiti Removers Evaluated

Sample	Product	Dilution
All Submitted Clay Brick	Sure Klean® Fast Acting Stripper	Concentrate
	Defacer Eraser® Graffiti Wipe	Concentrate

Dilution ratios refer to mixtures of concentrated cleaner : fresh water.



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

New Construction Cleaning

These cleaning trials were conducted to determine the optimal cleaning/cure time combination to most efficiently remove Type S mortar from the submitted clay brick while limiting surface alterations to the decorative finish.

Type S mortar was prepared in compliance with the manufacturer's instructions, applied to the brick surface and allowed to cure for 3, 7 and 14 days. Mortar removal was accomplished using chemical assistance and a high-pressure water rinse with pressure rinsing equipment. The removal of Type S was visually evaluated after 3, 7 and 14 days of curing. A visual examination was also made to determine if the tested cleaners caused any surface alterations to the submitted clay brick.

Description of Products Evaluated – New Construction Cleaning

Sure Klean® Vana Trol® – A concentrated acidic cleaner for new masonry surfaces that are subject to vanadium, manganese and other metallic stains. Use on: gray, brown, white, and most light-colored brick; natural stone; cast stone. Dissolves mortar smears and construction dirt quickly, leaving the masonry clean and uniform with no acid burning or streaking. Liquid concentrate for dilution with 4-10 parts water. Apply by brush or low-pressure spray.

Sure Klean® 600 Detergent – A general purpose, concentrated acidic cleaner for brick, tile and concrete surfaces. 600 Detergent dissolves mortar smears and construction dirt quickly, leaving the masonry clean and uniform with no acid burning or streaking.

Enviro Klean® Safety Klean – An effective, safe, alternative to acidic compounds for cleaning brick, tile, and concrete surfaces. Safety Klean rids new masonry construction of excess mortar, dirt and other common job site soiling. It's ideal for projects where traditional acidic cleaners are not allowed. Non-fuming Safety Klean contains no hydrochloric or other traditional inorganic acids and is safe for use on and around most metal surfaces. Always test. Additionally, it is up to 70 percent more effective than citric and glycolic acids, and 50 percent more effective than phosphoric acid.

Test Method – New Construction Cleaning

Chemical cleaners were evaluated using the following procedure:


1. Pre-wet the surface with water.
2. Apply the cleaner.
3. Allow the appropriate dwell time, as specified.

Sure Klean® Vana Trol®	3-5 minutes
Sure Klean® 600 Detergent	3-5 minutes
Enviro Klean® Safety Klean	3-5 minutes
4. Pressure rinse thoroughly.*

***Pressure Rinsing Equipment** – Masonry washing equipment generating approximately 700-800 psi with a water flow rate of 8 gallons per minute delivered through a 45 degree fan spray tip was used for rinsing.



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 5


Test Results – New Construction Cleaning

Cleaning Effectiveness (% Type S Mortar Removal)

“Ashland”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Birchwood Blend”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Black Wire-cut”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	99%	98%
Sure Klean® Vana Trol®	1:8	100%	99%	95%
Enviro Klean® Safety Klean	1:2	100%	99%	98%
Enviro Klean® Safety Klean	1:3	100%	98%	98%
“Brown Wire-cut”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Buffstone”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	98%
Sure Klean® Vana Trol®	1:8	100%	100%	98%
Enviro Klean® Safety Klean	1:2	100%	100%	98%
Enviro Klean® Safety Klean	1:3	100%	98%	98%
“Chocolate Wire-cut”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Dark Red Wire-cut”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® 600 Detergent	1:6	100%	100%	100%
Sure Klean® 600 Detergent	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 6


Test Results – New Construction Cleaning

Cleaning Effectiveness (% Type S Mortar Removal)

“Greystone .25”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Greystone .75”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Greystone 1.25”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Greystone 2.0”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Hampton”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Jamestown”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Kingsmill”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 7


Test Results – New Construction Cleaning

Cleaning Effectiveness (% Type S Mortar Removal)

“London Blast”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Old Marlborough”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Red Wire-cut”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® 600 Detergent	1:6	100%	100%	100%
Sure Klean® 600 Detergent	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%
“Savannah River”				
Product	Dilution	3 day	7 day	14 day
Sure Klean® Vana Trol®	1:6	100%	100%	100%
Sure Klean® Vana Trol®	1:8	100%	100%	100%
Enviro Klean® Safety Klean	1:2	100%	100%	100%
Enviro Klean® Safety Klean	1:3	100%	100%	100%



PALLET TAG PROGRAM LABORATORY REPORT




Test Results – Limiting Surface Alterations

Substrate: Clay Brick		Pigment Color: "Ashland"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0
Substrate: Clay Brick		Pigment Color: "Birchwood Blend"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0
Substrate: Clay Brick		Pigment Color: "Black Wire-cut"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0
Substrate: Clay Brick		Pigment Color: "Brown Wire-cut"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0
Substrate: Clay Brick		Pigment Color: "Buffstone"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0
Substrate: Clay Brick		Pigment Color: "Chocolate Wire-cut"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0

0 – No change 3 – change – heavy
 1 – change – slight 4 – change - excessive
 2 – change – moderate



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 9


Test Results – Limiting Surface Alterations

Substrate: Clay Brick		Pigment Color: "Dark Red Wire-cut"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® 600 Detergent	1:6	0	0	0	0
Sure Klean® 600 Detergent	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0
Substrate: Clay Brick		Pigment Color: "Greystone .25"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0
Substrate: Clay Brick		Pigment Color: "Greystone .75"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0
Substrate: Clay Brick		Pigment Color: "Greystone 1.25"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0
Substrate: Clay Brick		Pigment Color: "Greystone 2.0"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0
Substrate: Clay Brick		Pigment Color: "Hampton"			
Product	Dilution	Surface Finish Removal	Substrate Deterioration	Color Change	Staining
Sure Klean® Vana Trol®	1:6	0	0	0	0
Sure Klean® Vana Trol®	1:8	0	0	0	0
Enviro Klean® Safety Klean	1:2	0	0	0	0
Enviro Klean® Safety Klean	1:3	0	0	0	0

0 – No change 3 – change – heavy
 1 – change – slight 4 – change - excessive
 2 – change – moderate



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Photographs – New Construction Cleaning

“Brown Wire-cut” Clay Brick; 3 Day Cleaning



“Brown Wire-cut” Clay Brick; 7 Day Cleaning




“Brown Wire-cut” Clay Brick; 14 Day Cleaning





PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Photographs – New Construction Cleaning

“Dark Red Wire-cut” Clay Brick; 3 Day Cleaning



“Dark Red Wire-cut” Clay Brick; 7 Day Cleaning




“Dark Red Wire-cut” Clay Brick; 14 Day Cleaning





PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 13

Photographs – Limiting Surface Alterations

“Brown Wire-cut” Clay Brick; Limiting Surface Alterations



Sure Klean[®] Vana Trol[®] (1:6)	Sure Klean[®] Vana Trol[®] (1:8)	Enviro Klean[®] Safety Klean (1:2)	Enviro Klean[®] Safety Klean (1:3)	Untreated Control
---	---	--	--	--------------------------


“Dark Red Wire-cut” Clay Brick; Limiting Surface Alterations



Sure Klean[®] 600 Detergent (1:6)	Sure Klean[®] 600 Detergent (1:8)	Enviro Klean[®] Safety Klean (1:2)	Enviro Klean[®] Safety Klean (1:3)	Untreated Control
---	---	--	--	--------------------------



PALLET TAG PROGRAM LABORATORY REPORT



Conclusions – New Construction Cleaning

Based on the test results, all of the cleaners tested performed well in removing excess Type S mortar from the submitted clay brick even after allowing the mortar to remain on the surface of the brick for 14 days. In addition, test results indicate that none of the evaluated cleaners caused any noticeable surface alterations to any of the submitted clay brick.

It is recommended that the selected cleaners always be used in the lowest possible concentration. They should be rinsed with the lowest pressure of water as practical to minimize removal or alteration of the decorative finish. Excessive pressure and water volume may combine to damage or remove decorative finishes. To facilitate easier removal of excess mortar while minimizing any potential surface alterations to the decorative finish, clean within 3 days of construction for Type S mortar.

Recommendations – New Construction Cleaning


Recommendations for cleaning for each type of clay brick submitted by Palmetto Brick Company, Wallace, SC are provided in the chart below. Recommendations are based on the optimum dilution for complete removal of mortar while limiting surface alterations.

Sample	New Construction Cleaning (Type S mortar, 14 day cleaning)
"Ashland" "Birchwood Blend" "Black Wire-cut" "Brown Wire-cut" "Buffstone" "Chocolate Wire-cut" "Greystone .25" "Greystone .75" "Greystone 1.25" "Greystone 2.0" "Hampton" "Jamestown" "Kingsmill" "London Blast" "Old Marlborough" "Savannah River"	Sure Klean® Vana Trol® (1:8) OR Enviro Klean® Safety Klean (1:3)
"Dark Red Wire-cut" "Red Wire-cut"	Sure Klean® 600 Detergent (1:8) OR Enviro Klean® Safety Klean (1:3)

Apply all products in accordance with the manufacturer's recommendation provided on container labels and product data sheets. On-site testing should always be conducted to determine the most appropriate cleaning product and procedures for a particular project. See product literature for additional application and product information.



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 15

Protective Water Repellents

The testing described below evaluates the suitability of water repellent treatments.

The surface treatments evaluated were selected for their suitability for application based on the following selection criteria:

1. Weatherproofing properties
2. Color change
3. Ease of application

Description of Products Evaluated – Protective Water Repellents

Sure Klean® Weather Seal Blok-Guard® & Graffiti Control – A clear, solvent-based silicone elastomer formulated to weatherproof concrete block and other porous masonry materials. Blok-Guard® & Graffiti Control protects masonry surfaces from repeated graffiti attacks without altering the natural appearance. Blok-Guard® & Graffiti Control penetrates and fills pores to prevent water penetration through exterior walls exposed to normal weathering. Graffiti removal is fast and easy using Defacer Eraser® Graffiti Wipe. Blok-Guard® & Graffiti Control is easy to apply with low-pressure spray, brush or roller.

Sure Klean® Weather Seal Siloxane WB Concentrate – A self-emulsifying water repellent concentrate designed for dilution with fresh water at the job site. This solvent-free blend of silanes and oligomeric alkoxysiloxanes mixes easily with water to produce a penetrating water repellent ideal for application to dense or porous masonry surfaces.


Sure Klean® Weather Seal Siloxane PD – A ready-to-use, water-based silane/siloxane water repellent for concrete, GFRC, and most masonry and stucco surfaces. Siloxane PD penetrates more deeply than conventional water repellents. It helps masonry resist cracking, spalling, staining and other damage related to water intrusion. Low odor and alkaline stable, Siloxane PD is ideal for field and in-plant application.

Sample Preparation – Protective Water Repellents

The submitted brick were cut and allowed to dry for at least 24 hours prior to treatment. All of the treatments were applied by a wet-on-wet brushing application in accordance with the current PROSOCO, Inc. Product Data Sheet application instructions and allowed to cure for at least 72 hours prior to testing.



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 16

Test Methods – Protective Water Repellents

Water Absorption Tube Test: Vertical RILEM II.4, 5.0 milliliters, 20 minutes

The water absorption tube test simulating wind driven and wind blown rain conditions was performed. Tests were run with vertical 5.0-milliliter head pressures. Filled to 5.0 milliliters, a water absorption tube produces a 98 mph dynamic wind pressure. See RILEM II.4 Tech Note for additional information.

The ranking system used to evaluate the effectiveness of the products applied to each submitted sample is as follows:

AA = "Above Average" correlates to less than or equal to 20% of the maximum untreated absorption.

A = "Average" correlates to less than or equal to 50% of the maximum untreated absorption.

BA = "Below Average" correlates to greater than 50% of the maximum untreated absorption.

EXAMPLE: If RILEM tubes applied to an untreated sample result in loss of 5.0 mL of water or more, then:

A rating of **AA** *Above Average* water repellent performance would be reported for treatments which result in of no more than:

$$5.0 \text{ mL} \times 20\% = \mathbf{1.0 \text{ mL}}$$

A rating of **A** *Average* water repellent performance would be reported for treatments which result in loss of no more than:


$$5.0 \text{ mL} \times 50\% = \mathbf{2.5 \text{ mL}}$$

A rating of **BA** *Below Average* water repellent performance would be reported for treatments which result in a loss of more than:

$$5.0 \text{ mL} \times 50\% = \mathbf{2.5 \text{ mL}}$$



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 17

Test Results – Protective Water Repellents

Water Absorption Tube Test: Vertical RILEM II.4, 5.0 milliliters, 20 minutes

AA = Above Average


A = Average

BA = Below Average

“Ashland”	Results in mL loss	Ranking
Untreated Control	-2.8	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-1.5	BA
“Birchwood Blend”	Results in mL loss	Ranking
Untreated Control	-0.5	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Black Wire-cut”	Results in mL loss	Ranking
Untreated Control	-1.0	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.1	AA
“Brown Wire-cut”	Results in mL loss	Ranking
Untreated Control	-2.7	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-1.2	A
“Buffstone”	Results in mL loss	Ranking
Untreated Control	-0.7	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Chocolate Wire-cut”	Results in mL loss	Ranking
Untreated Control	-0.2	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Dark Red Wire-cut”	Results in mL loss	Ranking
Untreated Control	-1.1	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Greystone .25”	Results in mL loss	Ranking
Untreated Control	-1.1	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Greystone .75”	Results in mL loss	Ranking
Untreated Control	-3.4	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 18

Test Results – Protective Water Repellents

Water Absorption Tube Test: Vertical RILEM II.4, 5.0 milliliters, 20 minutes

AA = Above Average


A = Average

BA = Below Average

“Greystone 1.25”	Results in mL loss	Ranking
Untreated Control	-2.2	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Greystone 2.0”	Results in mL loss	Ranking
Untreated Control	-1.4	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Hampton”	Results in mL loss	Ranking
Untreated Control	-0.1	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Jamestown”	Results in mL loss	Ranking
Untreated Control	-5.0	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.7	AA
“Kingsmill”	Results in mL loss	Ranking
Untreated Control	-5.0	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.5	AA
“London Blast”	Results in mL loss	Ranking
Untreated Control	-0.6	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Old Marlborough”	Results in mL loss	Ranking
Untreated Control	-0.8	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Red Wire-cut”	Results in mL loss	Ranking
Untreated Control	-0.8	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.0	AA
“Savannah River”	Results in mL loss	Ranking
Untreated Control	-2.3	--
Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	-0.0	AA
Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)	-0.0	AA
Sure Klean® Weather Seal Siloxane PD	-0.6	A



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 19

Photographs – Protective Water Repellents

“London Blast”; Vertical 5.0 mL RILEM Testing, 20 minutes



Sure Klean® Weather
Seal Blok-Guard® &
Graffiti Control


Untreated Control

Sure Klean® Weather
Seal Siloxane WB
Concentrate (1:9)

Sure Klean® Weather
Seal Siloxane PD



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Conclusions – Protective Water Repellents

Test results indicate that at least one of the treatments evaluated exhibited above average water repellency on all of the submitted clay brick. In addition, Sure Klean® Weather Seal Blok-Guard® & Graffiti Control exhibited a slight color enhancement to the submitted clay brick. Neither Sure Klean® Weather Seal Siloxane WB Concentrate (1:9) nor Sure Klean® Weather Seal Siloxane PD altered the appearance of any of the submitted samples.

Recommendations – Protective Water Repellents

Recommendations for water repellent treatments for each type of clay brick submitted by Palmetto Brick Company, Wallace, SC are provided in the chart below. Recommendations are based on the treatments that proved most effective at providing water repellency on all types submitted.

Sample	Protective Water Repellents
"Birchwood Blend" "Black Wire-cut" "Buffstone" "Chocolate Wire-cut" "Dark Red Wire-cut" "Greystone .25" "Greystone .75" "Greystone 1.25" "Greystone 2.0" "Hampton" "Jamestown" "Kingsmill" "London Blast" "Old Marlborough" "Red Wire-cut"	*Sure Klean® Weather Seal Blok-Guard® & Graffiti Control OR Sure Klean® Weather Seal Siloxane WB Concentrate (1:9) OR Sure Klean® Weather Seal Siloxane PD
"Ashland" "Brown Wire-cut" "Savannah River"	*Sure Klean® Weather Seal Blok-Guard® & Graffiti Control OR Sure Klean® Weather Seal Siloxane WB Concentrate (1:9)


***NOTE:** Sure Klean® Weather Seal Blok-Guard® & Graffiti Control is manufactured and marketed in compliance with USEPA AIM VOC regulations (40 CFR 59.403). This product may not be suitable for sale in states and districts with more restrictive AIM VOC regulations.

It must be pointed out that in any installation, the brick are a single component of the masonry facade. The ability of a water repellent treatment to prevent the ingress of water is affected by a variety of other factors. Therefore, on-site testing should be carried out for all installations with the recommended systems to ensure job site workmanship yields equivalent results.

Apply all products in accordance with the manufacturer's recommendation provided on container labels and product data sheets. On-site testing should be conducted to determine the most appropriate water repellent product and procedures for a particular project. See product literature for additional application and product information.



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 21

Graffiti Control

These trials were conducted to determine the optimal graffiti control treatment for the submitted clay brick samples. This evaluation compares the effectiveness of the treatments tested to the untreated surfaces of the submitted samples in preventing staining of enamel spray paint and permanent markers.

Description of Products Evaluated – Graffiti Control

Graffiti Control Treatments

Sure Klean® Weather Seal Blok-Guard® & Graffiti Control – A clear, solvent-based silicone elastomer formulated to weatherproof concrete block and other porous masonry materials. Blok-Guard® & Graffiti Control protects masonry surfaces from repeated graffiti attacks without altering the natural appearance. Blok-Guard® & Graffiti Control penetrates and fills pores to prevent water penetration through exterior walls exposed to normal weathering. Graffiti removal is fast and easy using Defacer Eraser® Graffiti Wipe. Blok-Guard® & Graffiti Control is easy to apply with low-pressure spray, brush or roller.

Products Evaluated for Graffiti Removal

Sure Klean® Fast Acting Stripper – A thixotropic stripping compound formulated specifically for removal of high strength paints and coatings such as epoxies, polyurethanes, and floor enamels. Additionally, Fast Acting Stripper dissolves most spray paints, marking pens, lacquers and other graffiti.


Defacer Eraser® Graffiti Wipe – An easy-to-use graffiti remover that does not contain methanol, methylene chloride or other halogenated solvents prohibited on many projects. Graffiti Wipe removes a variety of graffiti stains from most smooth masonry, split-face concrete block, wood and metal surfaces.

Graffiti Agents

Interior/Exterior Spray Paint (Red)
Permanent Marker (Green)
Permanent Marker (Red)
Permanent Marker (Black)



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Sample Preparation – Graffiti Control

Sections of the clay brick samples were treated with Sure Klean® Weather Seal Blok-Guard® & Graffiti Control by brush in accordance with the current PROSOCO, Inc. Product Data Sheet application instructions and then allowed to cure for at least 24 hours. At the end of the one-day cure period, a visual adverse effects evaluation was made and then the graffiti agents were applied to the substrates.

Spray paint and markers were applied as graffiti agents to all treated surfaces no sooner than one day following application of Sure Klean® Weather Seal Blok-Guard® & Graffiti Control. Removal of the graffiti agents was attempted 24 hours after application of the graffiti agents, using Defacer Eraser® Graffiti Wipe and Sure Klean® Fast Acting Stripper.

Test Method – Graffiti Control


Chemical cleaners were evaluated using the following procedure:

1. Apply the product to a dry surface, soiled with graffiti.
2. Allow appropriate dwell time:
 - Fast Acting Stripper20 minutes
 - Graffiti Wipe 5 minutes
3. Pressure rinse thoroughly until water runs clear.*
4. Allow the surface to dry thoroughly and visually examine to determine effectiveness.

*Pressure Rinsing Equipment – Masonry washing equipment generating approximately 700-800 psi with a water flow rate of 8 gallons per minute delivered through a 45 degree fan spray tip was used for rinsing.



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.


Page 23

Test Results – Graffiti Control

“Ashland”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	75%	95%	70%	80%	80%
Graffiti Wipe	40%	30%	70%	70%	53%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	85%	100%	90%	90%	91%
Graffiti Wipe	90%	60%	90%	90%	83%
“Birchwood Blend”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	40%	90%	90%	80%	75%
Graffiti Wipe	60%	10%	90%	80%	60%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	95%	100%	100%	95%	98%
Graffiti Wipe	90%	90%	95%	95%	93%
“Black Wire-cut”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	90%	90%	70%	80%	83%
Graffiti Wipe	98%	70%	70%	80%	80%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	99%	100%	100%	100%	100%
Graffiti Wipe	99%	95%	100%	100%	99%
“Brown Wire-cut”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	100%	100%	90%	95%	96%
Graffiti Wipe	100%	60%	90%	95%	86%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	100%	100%	100%	100%	100%
Graffiti Wipe	100%	100%	100%	100%	100%
“Buffstone”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	85%	90%	40%	80%	74%
Graffiti Wipe	80%	30%	40%	80%	58%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	95%	95%	95%	95%	95%
Graffiti Wipe	99%	85%	95%	95%	94%
“Chocolate Wire-cut”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	90%	100%	90%	95%	94%
Graffiti Wipe	95%	90%	90%	90%	91%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	100%	100%	100%	100%	100%
Graffiti Wipe	100%	100%	100%	100%	100%
“Dark Red Wire-cut”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	85%	95%	90%	90%	90%
Graffiti Wipe	95%	80%	90%	90%	89%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	100%	100%	100%	100%	100%
Graffiti Wipe	100%	100%	100%	100%	100%



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.


Page 24

Test Results – Graffiti Control

“Greystone .25”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	80%	90%	60%	70%	75%
Graffiti Wipe	70%	20%	50%	50%	48%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	90%	99%	98%	95%	96%
Graffiti Wipe	98%	90%	98%	98%	96%
“Greystone .75”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	70%	95%	50%	90%	76%
Graffiti Wipe	80%	20%	50%	80%	58%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	95%	100%	98%	98%	98%
Graffiti Wipe	99%	90%	98%	98%	96%
“Greystone 1.25”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	80%	95%	60%	80%	79%
Graffiti Wipe	40%	30%	50%	80%	50%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	80%	100%	98%	98%	94%
Graffiti Wipe	99%	98%	98%	98%	98%
“Greystone 2.0”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	70%	95%	60%	90%	79%
Graffiti Wipe	80%	30%	70%	80%	65%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	99%	100%	100%	99%	100%
Graffiti Wipe	99%	100%	100%	99%	100%
“Hampton”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	95%	100%	100%	100%	99%
Graffiti Wipe	80%	80%	100%	100%	90%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	100%	100%	100%	100%	100%
Graffiti Wipe	100%	100%	100%	100%	100%
“Jamestown”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	90%	100%	70%	100%	90%
Graffiti Wipe	98%	70%	70%	100%	85%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	100%	100%	100%	100%	100%
Graffiti Wipe	100%	100%	100%	100%	100%
“Kingsmill”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	95%	100%	100%	100%	99%
Graffiti Wipe	75%	80%	100%	100%	89%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	100%	100%	100%	100%	100%
Graffiti Wipe	100%	100%	100%	100%	100%



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.


Page 25

Test Results – Graffiti Control

“London Blast”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	98%	100%	100%	100%	100%
Graffiti Wipe	98%	90%	100%	100%	97%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	100%	100%	100%	100%	100%
Graffiti Wipe	100%	100%	100%	100%	100%
“Old Marlborough”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	98%	100%	90%	100%	97%
Graffiti Wipe	98%	85%	90%	100%	93%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	100%	100%	100%	100%	100%
Graffiti Wipe	100%	100%	100%	100%	100%
“Red Wire-cut”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	98%	100%	90%	100%	97%
Graffiti Wipe	98%	75%	90%	100%	91%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	100%	100%	100%	100%	100%
Graffiti Wipe	100%	100%	100%	100%	100%
“Savannah River”					
Untreated Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	85%	95%	80%	90%	88%
Graffiti Wipe	75%	40%	70%	85%	68%
Blok-Guard® & Graffiti Control	Red Paint	Black Marker	Green Marker	Red Marker	% Avg. Removal
Fast Acting Stripper	95%	100%	90%	90%	94%
Graffiti Wipe	98%	100%	100%	100%	100%



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Page 26

Photographs – Graffiti Control


“Greystone .75”; Graffiti Applied



Sure Klean® Weather Seal Blok-Guard® & Graffiti Control

Untreated Control

“Greystone .75”; Graffiti Removed

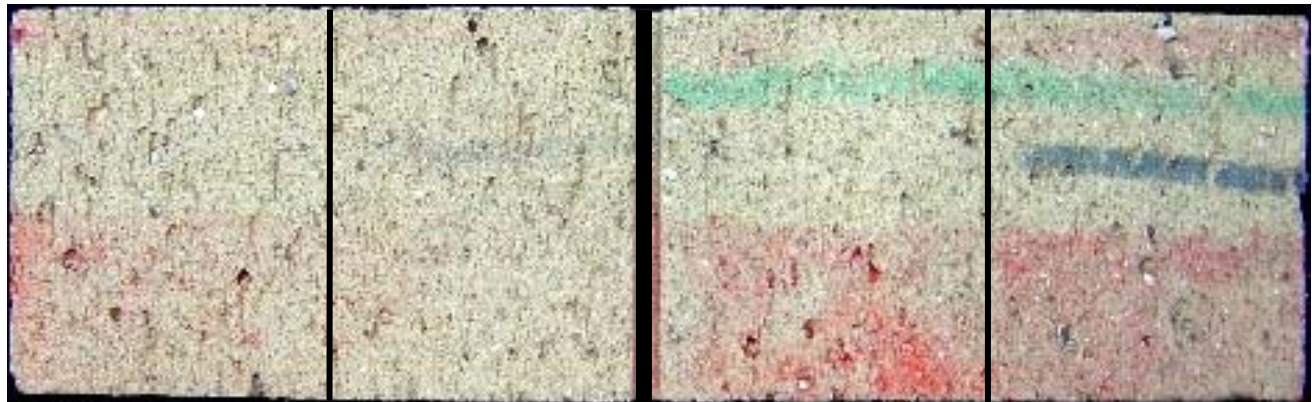

Sure Klean® Fast Acting Stripper

Defacer Eraser® Graffiti Wipe

Sure Klean® Fast Acting Stripper


Defacer Eraser® Graffiti Wipe

Sure Klean® Weather Seal Blok-Guard® & Graffiti Control

Untreated Control



PALLET TAG PROGRAM LABORATORY REPORT



PROSOCO, Inc.

Conclusions – Graffiti Control

Based upon laboratory evaluations, graffiti removal was improved when the submitted samples were treated with Sure Klean® Weather Seal Blok-Guard® & Graffiti Control prior to graffiti application. In addition, Sure Klean® Weather Seal Blok-Guard® & Graffiti Control exhibited a slight color enhancement to the submitted clay brick.

Recommendations – Graffiti Control


Recommendations for graffiti control treatment for each type of clay brick submitted by Palmetto Brick Company, Wallace, SC are provided in the chart below. Recommendations are based on the treatment that proved most effective for providing graffiti repellency and the product that was most effective at removing the graffiti on all types of clay brick submitted.

Sample	Graffiti Repellent	Graffiti Removers
All Submitted Clay Brick	*Sure Klean® Weather Seal Blok-Guard® & Graffiti Control	Sure Klean® Fast Acting Stripper OR Defacer Eraser® Graffiti Wipe

***NOTE:** Sure Klean® Weather Seal Blok-Guard® & Graffiti Control is manufactured and marketed in compliance with USEPA AIM VOC regulations (40 CFR 59.403). This product may not be suitable for sale in states and districts with more restrictive AIM VOC regulations.

Apply all products in accordance with the manufacturer's recommendation provided on container labels and product data sheets. Because the severity of graffiti varies from location to location, on-site testing should be conducted to determine the most appropriate graffiti control product and procedure for a particular project. See product literature for additional application and product information.

Christopher A. Moore
Project Testing Laboratory Technician
CAM



Laboratory Report

Pallet Tag Program Evaluation

Palmetto Brick Company Wallace, SC

Project No. 0509-06 PTP

Prepared For:

**Palmetto Brick Company
3501 Brickyard Road
Wallace, SC 29596**

Prepared By:

**PROSOCO, Inc.
April 2006**